









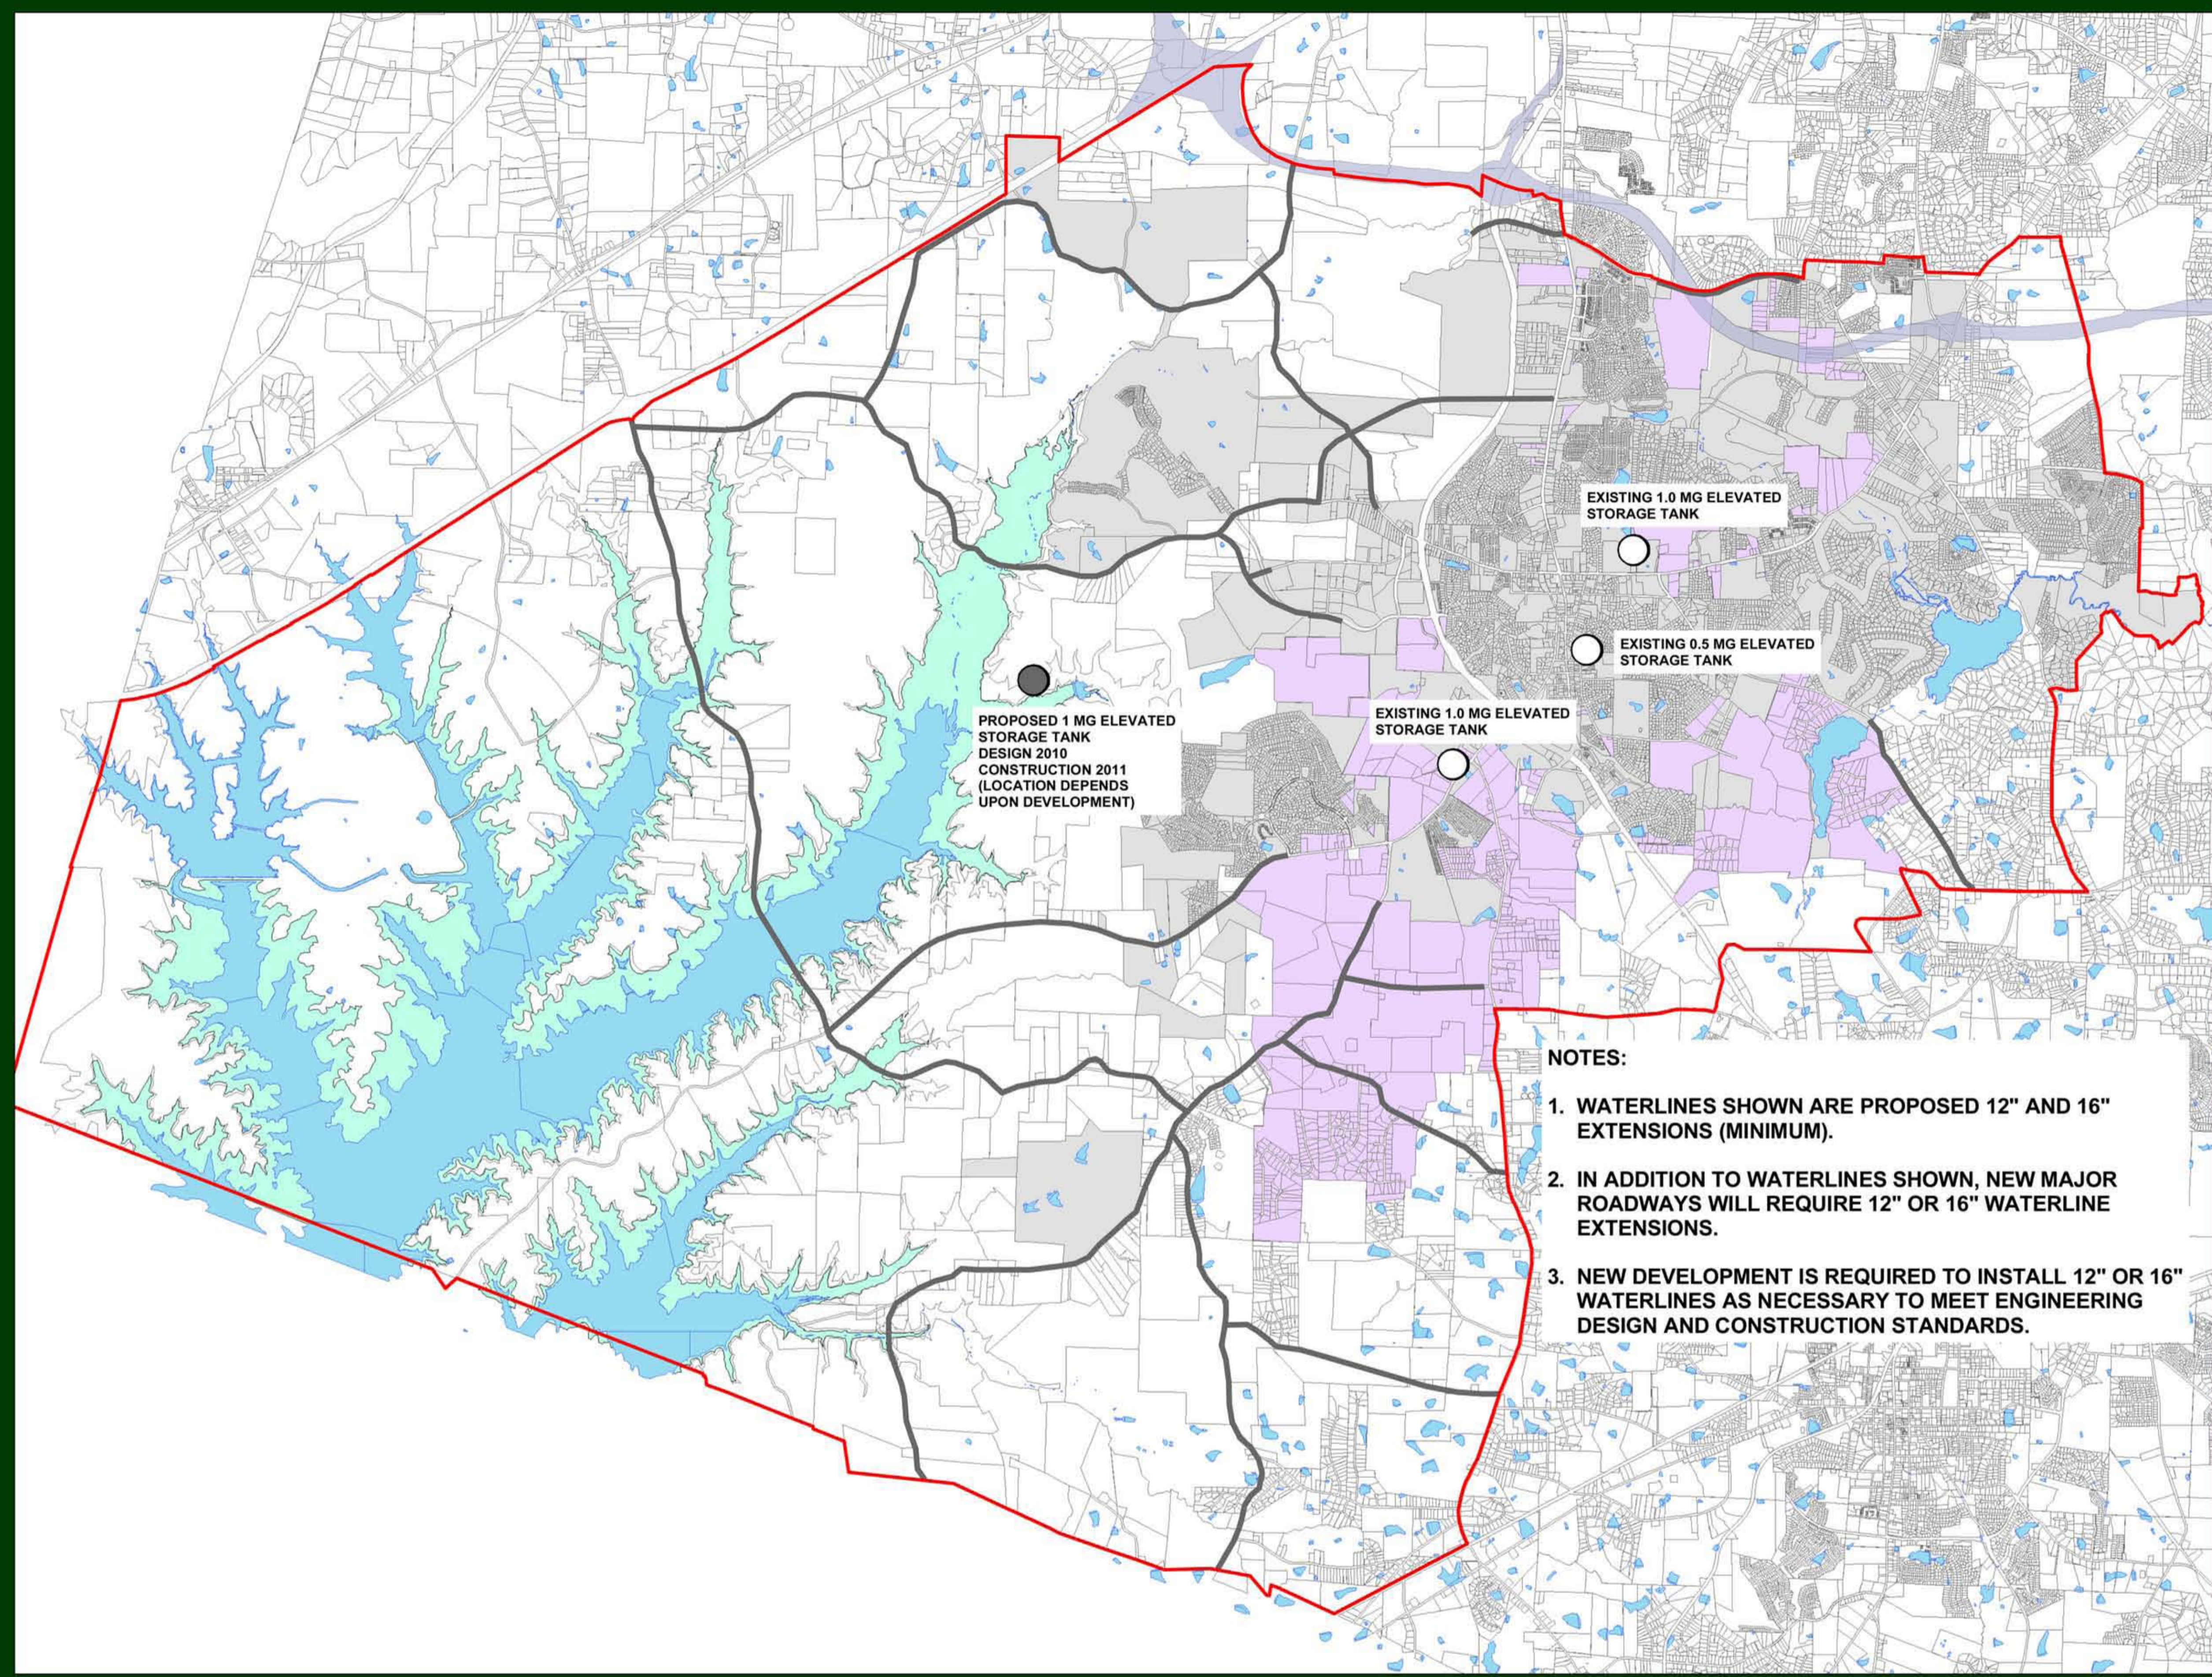


LONG RANGE WATER
CAPITAL IMPROVEMENTS PLAN
(MAJOR PROJECTS)

Legend

-  Proposed Water Tank
-  Existing Water Tank
-  Long Range Planning Area
-  CIP Water Lines
-  Outer Loop
-  Town ETJ Area
-  Water Surface
-  Prop Future Harris Lk Water Surface 240Ft Elevation
-  Property Parcels
-  Town Limits



PROPOSED 1 MG ELEVATED STORAGE TANK
DESIGN 2010
CONSTRUCTION 2011
(LOCATION DEPENDS UPON DEVELOPMENT)

EXISTING 1.0 MG ELEVATED STORAGE TANK

EXISTING 0.5 MG ELEVATED STORAGE TANK

EXISTING 1.0 MG ELEVATED STORAGE TANK

NOTES:

1. WATERLINES SHOWN ARE PROPOSED 12" AND 16" EXTENSIONS (MINIMUM).
2. IN ADDITION TO WATERLINES SHOWN, NEW MAJOR ROADWAYS WILL REQUIRE 12" OR 16" WATERLINE EXTENSIONS.
3. NEW DEVELOPMENT IS REQUIRED TO INSTALL 12" OR 16" WATERLINES AS NECESSARY TO MEET ENGINEERING DESIGN AND CONSTRUCTION STANDARDS.



0 2,600 5,200
Feet

1 inch equals 2,600 feet

September 2009 Update

For More Information Contact:
Town of Holly Springs
Engineering Department
P.O. Box 8
Holly Springs, NC 27540
919.557.3938
www.hollyspringsnc.us

The Town expressly denies any and all responsibility for errors, if any, in the information/data or for the misuse of the information/data by the user or anyone else. The user understands that he or she should verify the accuracy of the information/data before using it.